

## Luminaire Photograph



Light Output Ratio:	80.9%	
Luminaire Power:	27.47 W	
SHR Nominal:	0.50	Calculated using the TM5
SHR Maximum:	0.65	fine grid method.

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: Zoe  
Test Date: 2022-8-17

g Range: 0 - 180DEG  
g Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity: 65.0%  
Test Distance: 3.160m [K=1.0000]  
Remarks: LAMP: BXRE-30G2000-C-83 Ra: 90  
LENS: PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

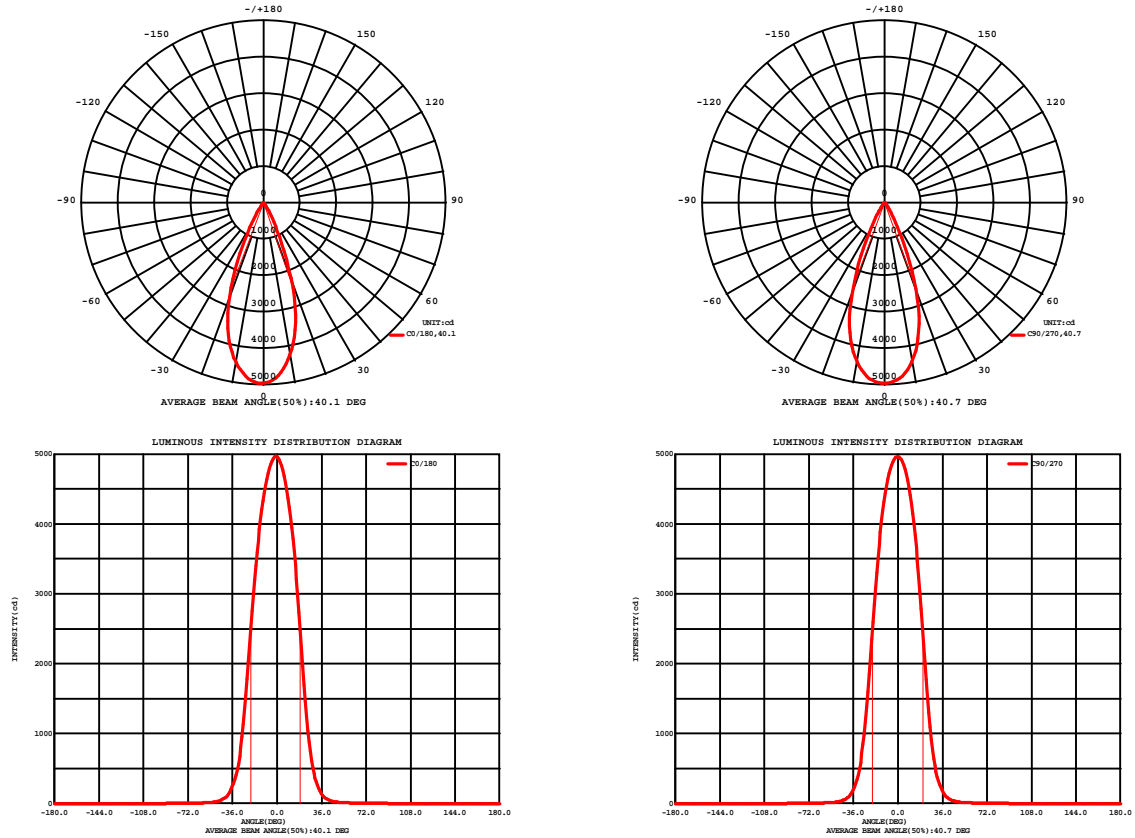


Fig. C0/C180

Fig. C90/C270


C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: Zoe  
Test Date: 2022-8-17

Range: 0 - 180DEG  
Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity: 65.0%  
Test Distance: 3.160m [K=1.0000]  
Remarks: LAMP: BXRE-30G2000-C-83 Ra: 90  
LENS: PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 82.37 lm/W			
MODEL	Bridgelux	Imax(cd)	4965	S/MH(C0/180)	0.65
NOMINAL POWER(W)	27	LOR(%)	80.9	S/MH(C90/270)	0.63
RATED VOLTAGE(V)	120	TOTAL FLUX(lm)	2263.0	h UP,DN(C0-180)	0.0,39.1
NOMINAL FLUX(lm)	2796.63	CIE CLASS	DIRECT	h UP,DN(C180-360)	0.0,41.8
LAMPS INSIDE	1	h up(%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE(V)	120	h down(%)	80.9	CIBSE SHR MAX	0.65

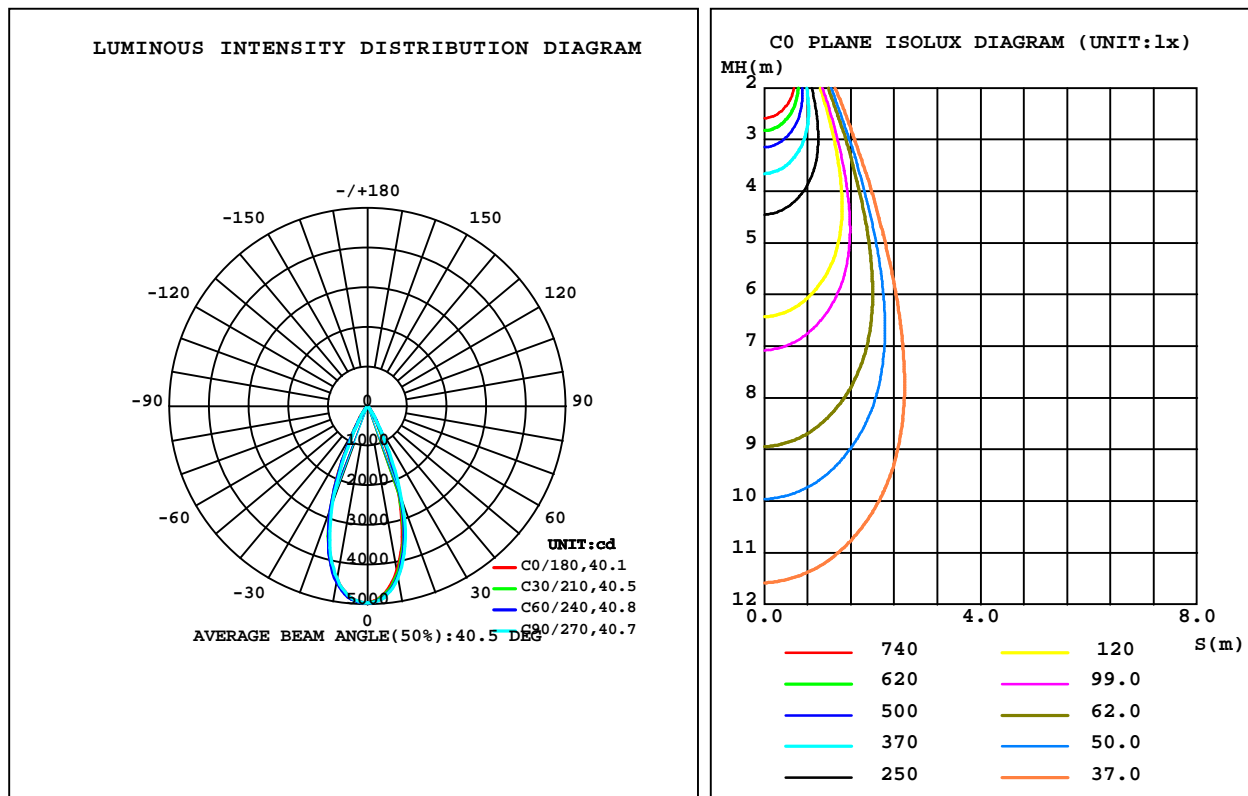

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Zoe  
 Test Date:2022-8-17

g Range: 0 - 180DEG  
 Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
 Humidity:65.0%  
 Test Distance:3.160m [K=1.0000]  
 Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
 LENS:PM-1083A 24R  
 DRIVER: PUP40A-1WMC-850 700mA  
 30minutes warm-up

### ZONAL FLUX DIAGRAM

#### ZONAL FLUX DIAGRAM:


g	C0	C45	C90	C135	C180	C225	C270	C315	g	F zone	F total	%lum, lamp
10	4236	4341	4413	4362	4445	4506	4433	4322	0- 10	446.3	446.3	19.7,16
20	2217	2366	2539	2566	2754	2746	2599	2443	10- 20	984.4	1431	63.2,51.2
30	428.7	471.4	534.8	566.0	673.0	676.6	578.7	511.8	20- 30	619.6	2050	90.6,73.3
40	69.47	73.79	83.71	90.84	107.5	103.2	90.91	78.13	30- 40	157.8	2208	97.6,79
50	17.53	18.88	19.56	20.15	22.37	20.35	18.66	19.32	40- 50	33.36	2242	99.1,80.2
60	7.891	8.514	8.653	9.054	9.036	9.010	8.511	8.914	50- 60	11.94	2254	99.6,80.6
70	3.780	4.017	3.954	4.370	4.340	4.250	4.061	4.267	60- 70	6.181	2260	99.9,80.8
80	1.217	1.211	1.267	1.464	1.544	1.386	1.290	1.384	70- 80	2.789	2262	100,80.9
90	0	0	0	0	0	0	0	0	80- 90	0.5395	2263	100,80.9
100	0	0	0	0	0	0	0	0	90-100	0	2263	100,80.9
110	0	0	0	0	0	0	0	0	100-110	0	2263	100,80.9
120	0	0	0	0	0	0	0	0	110-120	0	2263	100,80.9
130	0	0	0	0	0	0	0	0	120-130	0	2263	100,80.9
140	0	0	0	0	0	0	0	0	130-140	0	2263	100,80.9
150	0	0	0	0	0	0	0	0	140-150	0	2263	100,80.9
160	0	0	0	0	0	0	0	0	150-160	0	2263	100,80.9
170	0	0	0	0	0	0	0	0	160-170	0	2263	100,80.9
180	0	0	0	0	0	0	0	0	170-180	0	2263	100,80.9
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## LUMINANCE LIMITATION CURVES

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

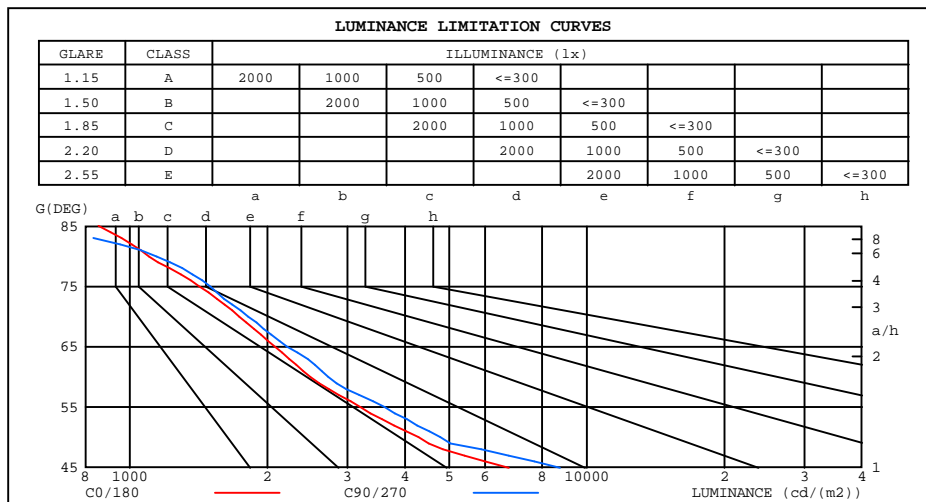


C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

G Range: 0 - 180DEG  
G Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

rcc	80%			70%			50%			30%			10%			0
rw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r <sub>fc</sub>	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio                      Coefficients of Utilization(CU)															
0.0	.96	.96	.96	.94	.94	.94	.90	.90	.90	.86	.86	.86	.83	.83	.83	.81
1.0	.91	.89	.87	.89	.87	.86	.86	.84	.83	.83	.82	.81	.80	.79	.79	.77
2.0	.86	.83	.80	.84	.82	.80	.82	.80	.78	.79	.78	.76	.77	.76	.75	.73
3.0	.81	.78	.75	.80	.77	.74	.78	.75	.73	.76	.74	.72	.74	.73	.71	.70
4.0	.77	.73	.71	.76	.73	.70	.75	.72	.69	.73	.71	.69	.72	.69	.68	.67
5.0	.73	.70	.67	.73	.69	.66	.71	.68	.66	.70	.67	.65	.69	.67	.65	.64
6.0	.70	.66	.63	.70	.66	.63	.68	.65	.63	.67	.64	.62	.66	.64	.62	.61
7.0	.67	.63	.60	.67	.63	.60	.66	.62	.60	.65	.62	.60	.64	.61	.59	.58
8.0	.64	.60	.58	.64	.60	.57	.63	.60	.57	.62	.59	.57	.62	.59	.57	.56
9.0	.62	.58	.55	.61	.58	.55	.61	.57	.55	.60	.57	.55	.59	.57	.55	.54
10.0	.59	.55	.53	.59	.55	.53	.58	.55	.53	.58	.55	.53	.57	.54	.52	.52

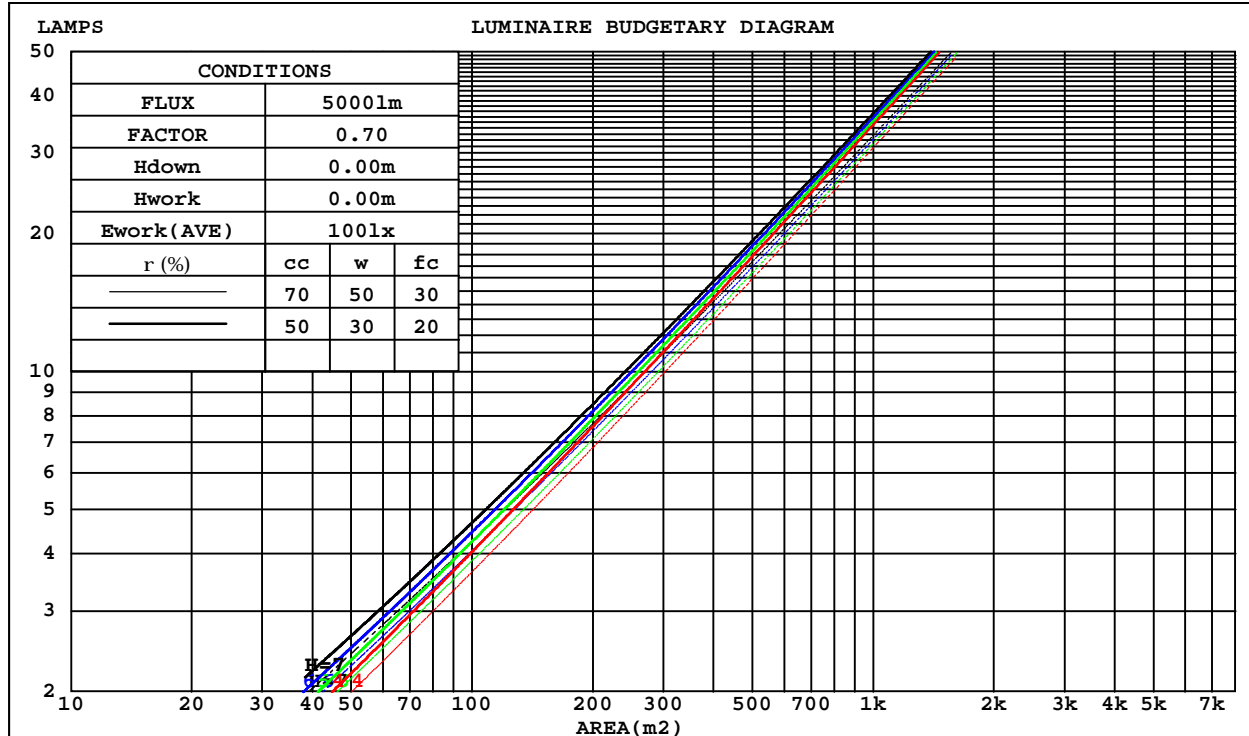

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

### WEC AND CCEC

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

rcc	80%			70%			50%			30%			10%			0
rw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
rfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Wall Exitance Coefficients(WEC)															
0.0																
1.0	.125	.071	.022	.119	.068	.022	.109	.063	.020	.100	.058	.019	.091	.053	.017	
2.0	.117	.064	.020	.113	.062	.019	.104	.058	.018	.097	.054	.017	.089	.051	.016	
3.0	.110	.059	.018	.107	.057	.017	.100	.054	.016	.093	.051	.016	.087	.048	.015	
4.0	.104	.054	.016	.101	.053	.016	.095	.050	.015	.090	.048	.015	.084	.046	.014	
5.0	.099	.050	.015	.096	.049	.014	.091	.047	.014	.086	.046	.014	.082	.044	.013	
6.0	.094	.047	.014	.092	.046	.013	.087	.045	.013	.083	.043	.013	.079	.042	.012	
7.0	.090	.044	.013	.088	.044	.012	.084	.042	.012	.080	.041	.012	.077	.040	.012	
8.0	.086	.042	.012	.084	.041	.012	.081	.040	.012	.077	.039	.011	.074	.038	.011	
9.0	.083	.040	.011	.081	.039	.011	.078	.038	.011	.075	.038	.011	.072	.037	.011	
10.0	.079	.038	.011	.078	.038	.010	.075	.037	.010	.072	.036	.010	.070	.035	.010	

rcc	80%			70%			50%			30%			10%			0
rw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
rfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.154	.154	.154	.132	.132	.132	.090	.090	.090	.052	.052	.052	.017	.017	.017	
1.0	.137	.127	.119	.117	.109	.102	.080	.075	.071	.046	.044	.041	.015	.014	.013	
2.0	.124	.107	.094	.106	.092	.081	.073	.064	.056	.042	.037	.033	.013	.012	.011	
3.0	.112	.092	.075	.096	.079	.065	.066	.055	.046	.038	.032	.027	.012	.010	.009	
4.0	.103	.080	.062	.088	.069	.054	.061	.048	.038	.035	.028	.022	.011	.009	.007	
5.0	.095	.070	.051	.082	.060	.045	.056	.042	.031	.033	.025	.019	.011	.008	.006	
6.0	.088	.062	.043	.076	.054	.037	.052	.038	.026	.030	.022	.016	.010	.007	.005	
7.0	.083	.056	.037	.071	.048	.032	.049	.034	.023	.029	.020	.013	.009	.007	.004	
8.0	.078	.050	.031	.067	.044	.027	.046	.031	.019	.027	.018	.012	.009	.006	.004	
9.0	.074	.046	.027	.063	.040	.024	.044	.028	.017	.026	.017	.010	.008	.005	.003	
10.0	.070	.042	.024	.060	.037	.021	.042	.026	.015	.024	.015	.009	.008	.005	.003	

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
g Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## UGR(Unified Glare Rating) Table

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm										
NAME: 2018.481-ACOT-84-AM					TYPE:			WEIGHT:		
SPEC.:3000K					DIM.:			SERIAL No.:2208170671		
MFR.: RISE					SUR.:0.0063585m2			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	11.8	12.6	12.0	12.8	12.9	12.7	13.4	12.9	13.6	13.8
3H	11.8	12.5	12.0	12.7	12.9	12.6	13.3	12.9	13.5	13.7
4H	11.8	12.4	12.0	12.6	12.9	12.6	13.3	12.8	13.5	13.7
6H	11.7	12.3	12.0	12.6	12.8	12.5	13.2	12.8	13.4	13.6
8H	11.7	12.3	12.0	12.5	12.8	12.5	13.1	12.8	13.3	13.6
12H	11.6	12.2	11.9	12.5	12.8	12.4	13.0	12.8	13.3	13.6
4H 2H	11.7	12.4	11.9	12.6	12.8	12.5	13.2	12.8	13.4	13.6
3H	11.7	12.3	12.0	12.5	12.8	12.5	13.1	12.8	13.3	13.6
4H	11.6	12.2	12.0	12.5	12.8	12.4	13.0	12.8	13.3	13.6
6H	11.6	12.1	12.0	12.4	12.7	12.4	12.9	12.8	13.2	13.5
8H	11.6	12.0	12.0	12.4	12.7	12.4	12.8	12.7	13.1	13.5
12H	11.5	11.9	11.9	12.3	12.7	12.3	12.7	12.7	13.1	13.5
8H 4H	11.5	12.0	11.9	12.3	12.7	12.3	12.8	12.7	13.1	13.5
6H	11.5	11.9	11.9	12.3	12.7	12.3	12.7	12.7	13.0	13.5
8H	11.5	11.8	11.9	12.2	12.6	12.3	12.6	12.7	13.0	13.4
12H	11.4	11.7	11.9	12.1	12.6	12.2	12.5	12.7	12.9	13.4
12H 4H	11.5	11.9	11.9	12.3	12.7	12.3	12.7	12.7	13.1	13.4
6H	11.5	11.8	11.9	12.2	12.6	12.2	12.6	12.7	13.0	13.4
8H	11.4	11.7	11.9	12.1	12.6	12.2	12.5	12.7	12.9	13.4
Variations with the observer position at spacings:										
S = 1.0H	+ 2.7 / - 4.0					+ 3.4 / - 4.3				
1.5H	+ 4.6 / - 3.1					+ 5.4 / - 3.5				
2.0H	+ 2.6 / - 1.6					+ 3.7 / - 1.7				

CIE Pub.117, 2797 lm Total Lamp Luminous Flux Corrected ( $8\log(F/F_0) = 3.6$ )  
Area: 0.0063585 m2

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
g Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up



### UTILIZATION FACTORS TABLE

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	73	68	65	72	68	65	72	68	65	62
0.80	79	74	71	78	74	71	77	74	71	68
1.00	82	78	75	81	77	75	80	77	74	71
1.25	85	81	78	84	80	78	82	79	77	74
1.50	87	83	81	86	83	80	84	81	79	76
2.00	89	85	83	87	85	82	85	83	81	77
2.50	90	87	85	89	86	84	86	84	82	78
3.00	91	88	86	90	87	85	87	85	84	79
4.00	93	90	89	91	89	88	88	87	86	80
5.00	93	92	90	92	90	89	89	88	87	81
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Zoe  
 Test Date:2022-8-17

g Range: 0 - 180DEG  
 g Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
 Humidity:65.0%  
 Test Distance:3.160m [K=1.0000]  
 Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
 LENS:PM-1083A 24R  
 DRIVER: PUP40A-1WMC-850 700mA  
 30minutes warm-up

## ISOCANDELA DIAGRAM

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

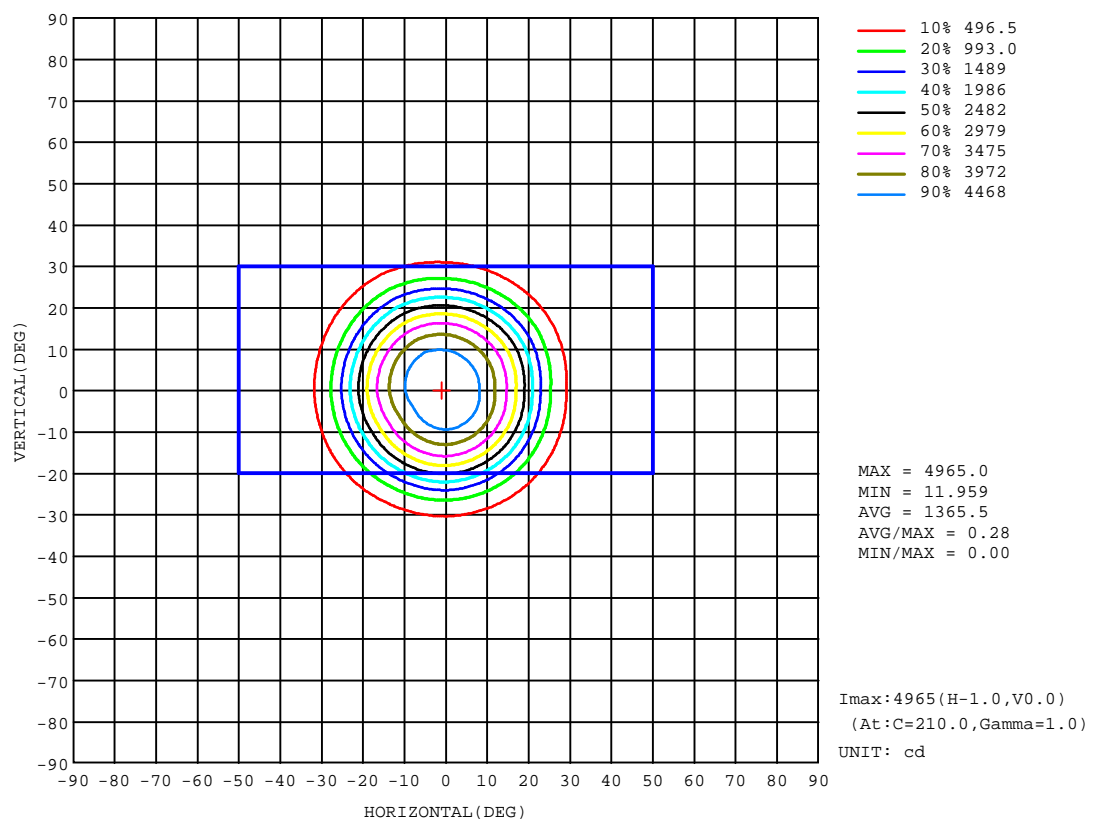


C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## AAI Figure

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

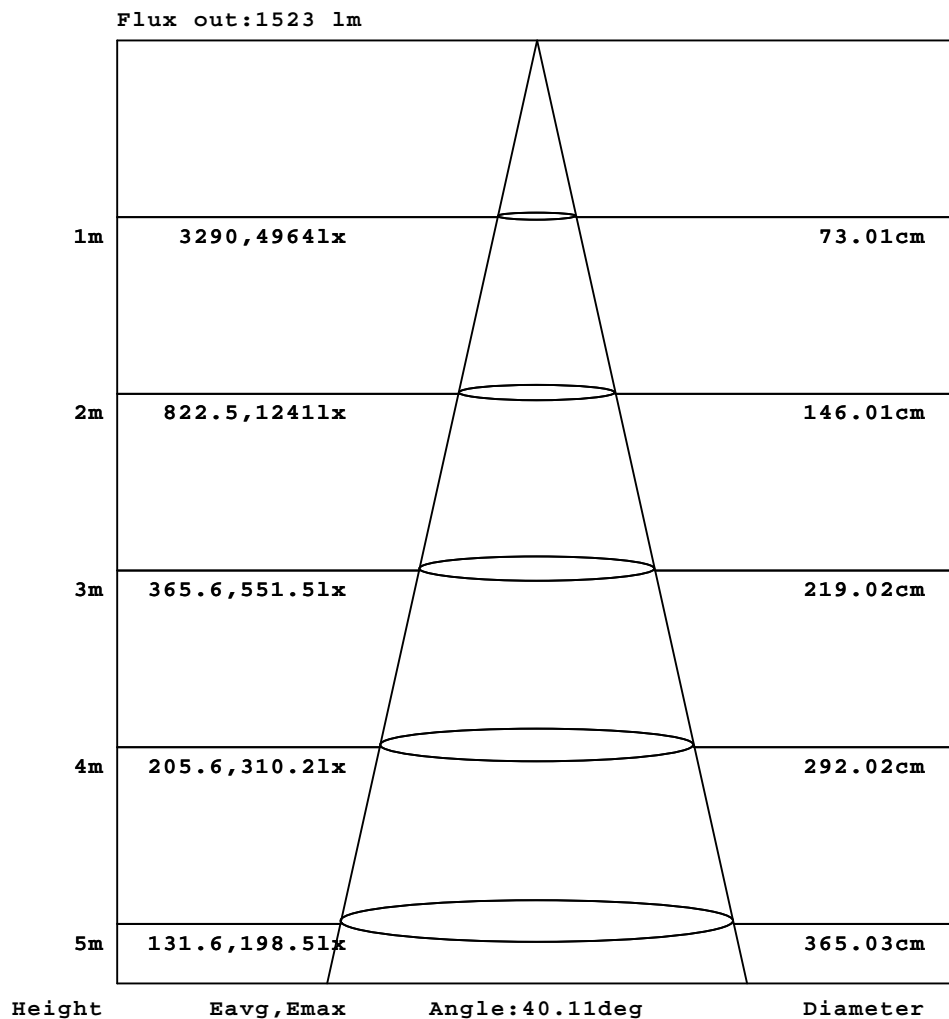

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.


C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up



## ISOLUX DIAGRAM

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

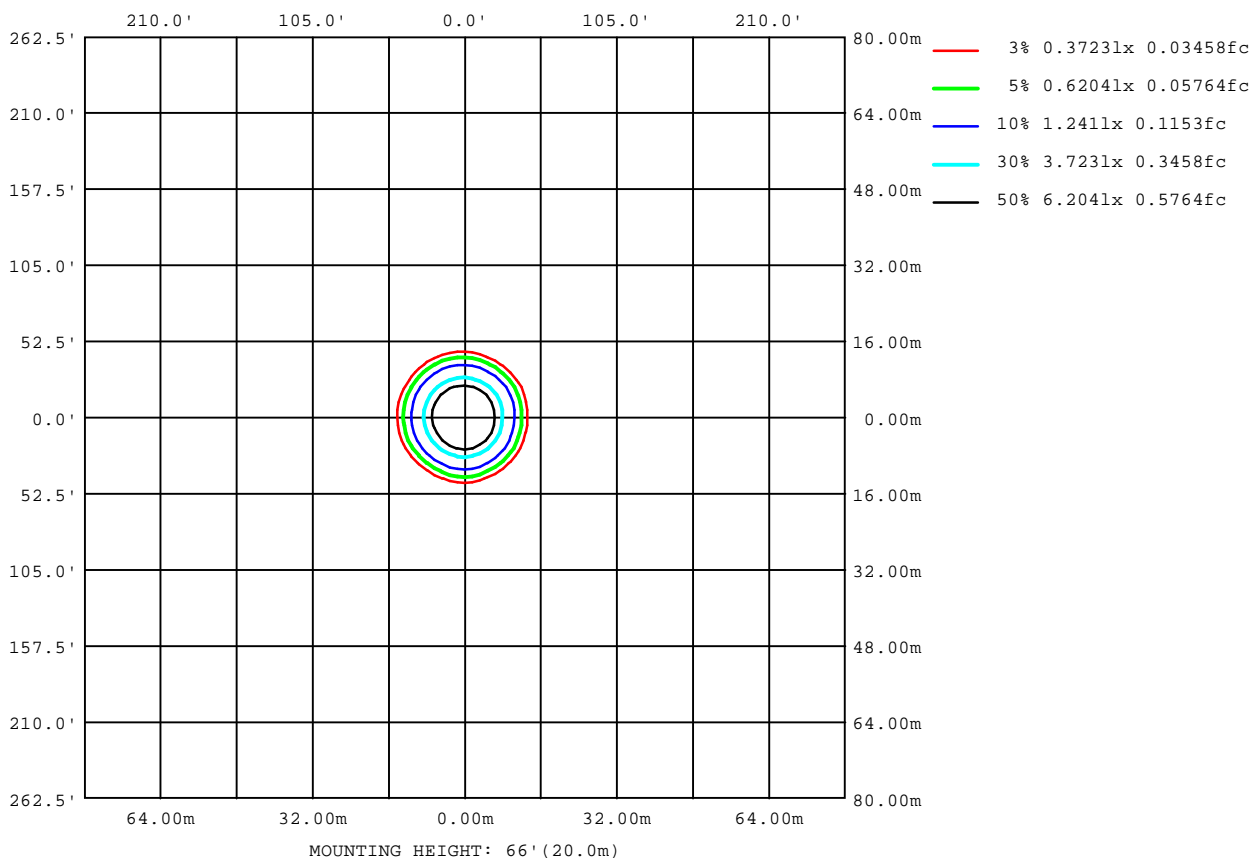

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
g Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## LED Avg.L Report

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	2220
L_0~180(75)av	1557
L_0~180(85)av	1016
L_90~270(65)av	2229
L_90~270(75)av	1518
L_90~270(85)av	528
L_45(65)av	2340
L_45(75)av	1601
L_45(85)av	668

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up

## Planar Illuminance Curve

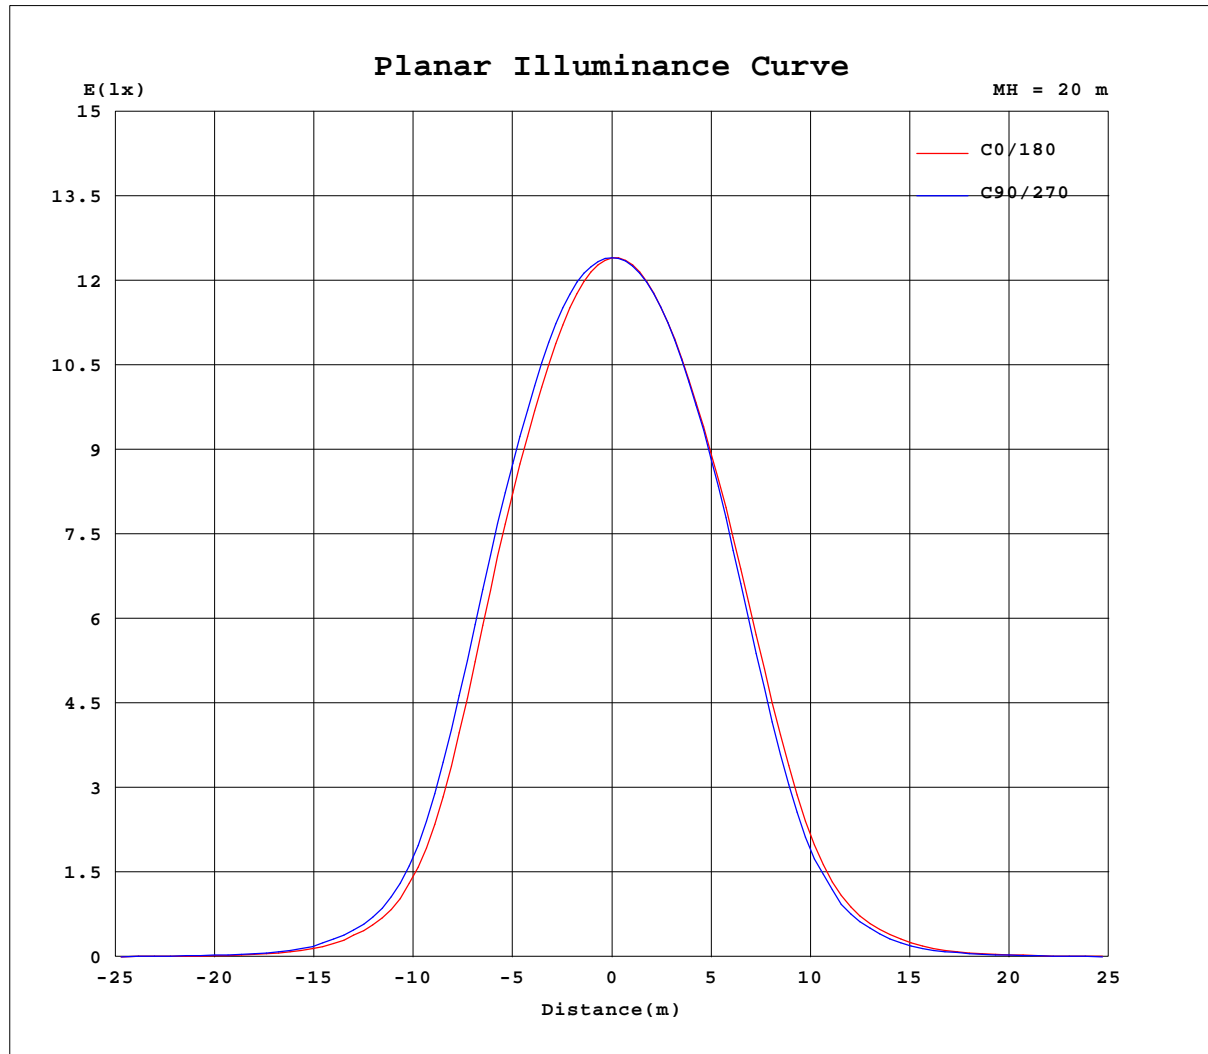

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Zoe  
 Test Date: 2022-8-17

g Range: 0 - 180DEG  
 Interval: 1.0DEG  
 Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
 Humidity: 65.0%  
 Test Distance: 3.160m [K=1.0000]  
 Remarks: LAMP: BXRE-30G2000-C-83 Ra: 90  
 LENS: PM-1083A 24R  
 DRIVER: PUP40A-1WMC-850 700mA  
 30minutes warm-up

## LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:119.90V I:0.2309A P:27.472W PF:0.9909 Freq:59.98Hz Lamp Flux:2796.63x1 lm		
NAME: 2018.481-ACOT-84-AM	TYPE:	WEIGHT:
SPEC.:3000K	DIM.:	SERIAL No.:2208170671
MFR.: RISE	SUR.:0.0063585m2	Shielding Angle:

Table--1

UNIT: cd

C(°) g (°)	0	30	60	90	120	150	180	210	240	270	300	330						
0	4963	4963	4963	4963	4963	4963	4963	4963	4963	4963	4963	4963						
5	4762	4789	4826	4842	4819	4796	4850	4874	4881	4843	4806	4784						
10	4236	4310	4373	4413	4382	4341	4445	4496	4516	4433	4349	4294						
15	3410	3497	3581	3658	3639	3627	3763	3802	3809	3704	3596	3529						
20	2217	2311	2422	2539	2549	2583	2754	2755	2738	2599	2473	2412						
25	1042	1107	1196	1298	1304	1400	1547	1532	1528	1379	1271	1222						
30	429	455	488	535	533	599	673	689	665	579	522	501						
35	175	195	196	232	220	263	292	284	275	236	217	205						
40	69.5	71.9	75.7	83.7	86.1	95.6	108	105	101	90.9	77.0	79.3						
45	30.4	34.1	35.2	39.4	39.6	44.4	48.5	48.0	45.7	40.3	36.3	36.4						
50	17.5	18.9	18.9	19.6	19.4	20.9	22.4	19.8	20.9	18.7	19.6	19.0						
55	11.7	12.7	13.1	13.2	13.5	13.8	13.5	13.5	13.3	12.6	13.0	13.5						
60	7.89	8.23	8.80	8.65	8.95	9.15	9.04	9.06	8.96	8.51	8.75	9.08						
65	5.59	5.82	6.19	5.95	6.29	6.54	6.34	6.24	6.35	6.03	6.22	6.38						
70	3.78	3.87	4.16	3.95	4.27	4.47	4.34	4.21	4.29	4.06	4.21	4.32						
75	2.34	2.32	2.57	2.47	2.66	2.83	2.78	2.61	2.68	2.52	2.62	2.69						
80	1.22	1.12	1.30	1.27	1.39	1.54	1.54	1.35	1.43	1.29	1.34	1.43						
85	0.47	0.30	0.28	0.29	0.36	0.51	0.65	0.44	0.40	0.30	0.30	0.41						
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00						

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Zoe  
Test Date:2022-8-17

g Range: 0 - 180DEG  
g Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.416  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks: LAMP:BXRE-30G2000-C-83 Ra:90  
LENS:PM-1083A 24R  
DRIVER: PUP40A-1WMC-850 700mA  
30minutes warm-up